

The filter media professionals


**PRODUCT DATA SHEET**

**Product:** #6.5 (0.8 -1.8 mm NOM +/-8%)

**Appearance:** Dry sand, graded to the above specification

**Main Applications:** Filtration Medium

**Indicative Grade Analysis:** Sieve Standards: ASTM C136, AS1141.11, AWS App B  
 Sampling Methods: ASTM D75, AS1141.3.1

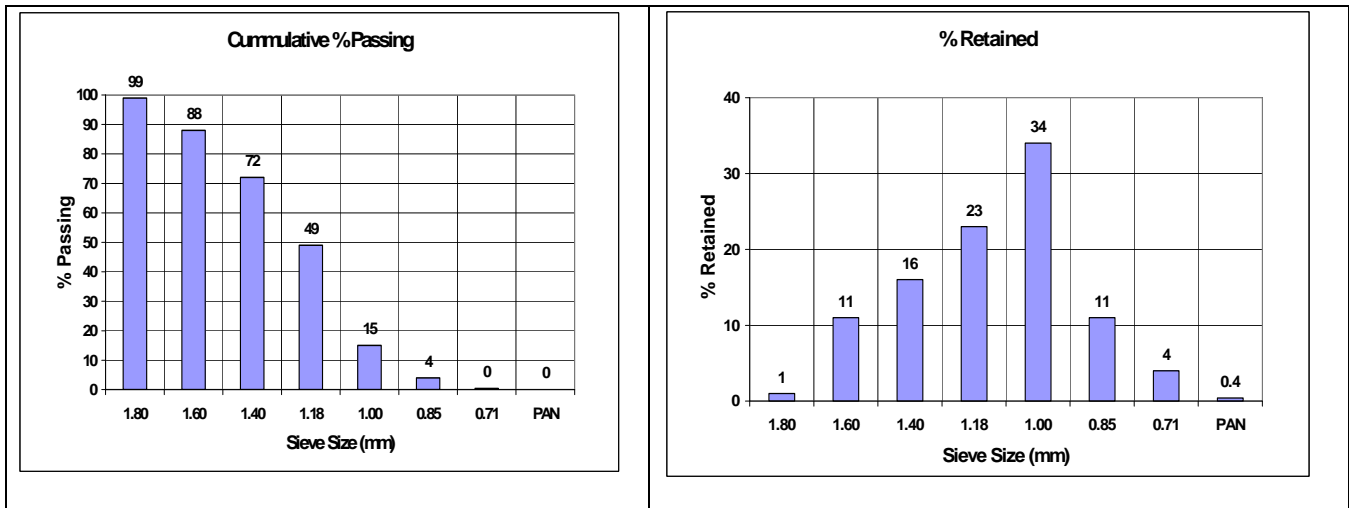

**Note:** Indicative grading only. Grading analysis will vary slightly over time due to changes in raw feed.

**Other Properties**

**Moisture Content** <5%  
**Bulk Density** approx. 1.4 t/m<sup>3</sup>  
**Acid Solubility** <1%  
**Material <75 µm** <1%  
**Specific Gravity** >2.5

**Test Methods**

AS 1289.2.1.1  
 AS1141.4, AWS App D  
 AWWA-B100 (50% HCl)  
 ASTM C117, AS1141.12  
 ASTM C128, AS 1141.5

River Sands operates and maintains a Quality Certified system in accordance with AS/NZS ISO 9001

The Quality system is third party certified by NATA.

River Sands also maintains a registered NATA laboratory.

Registration # 6898

Registration # 10470